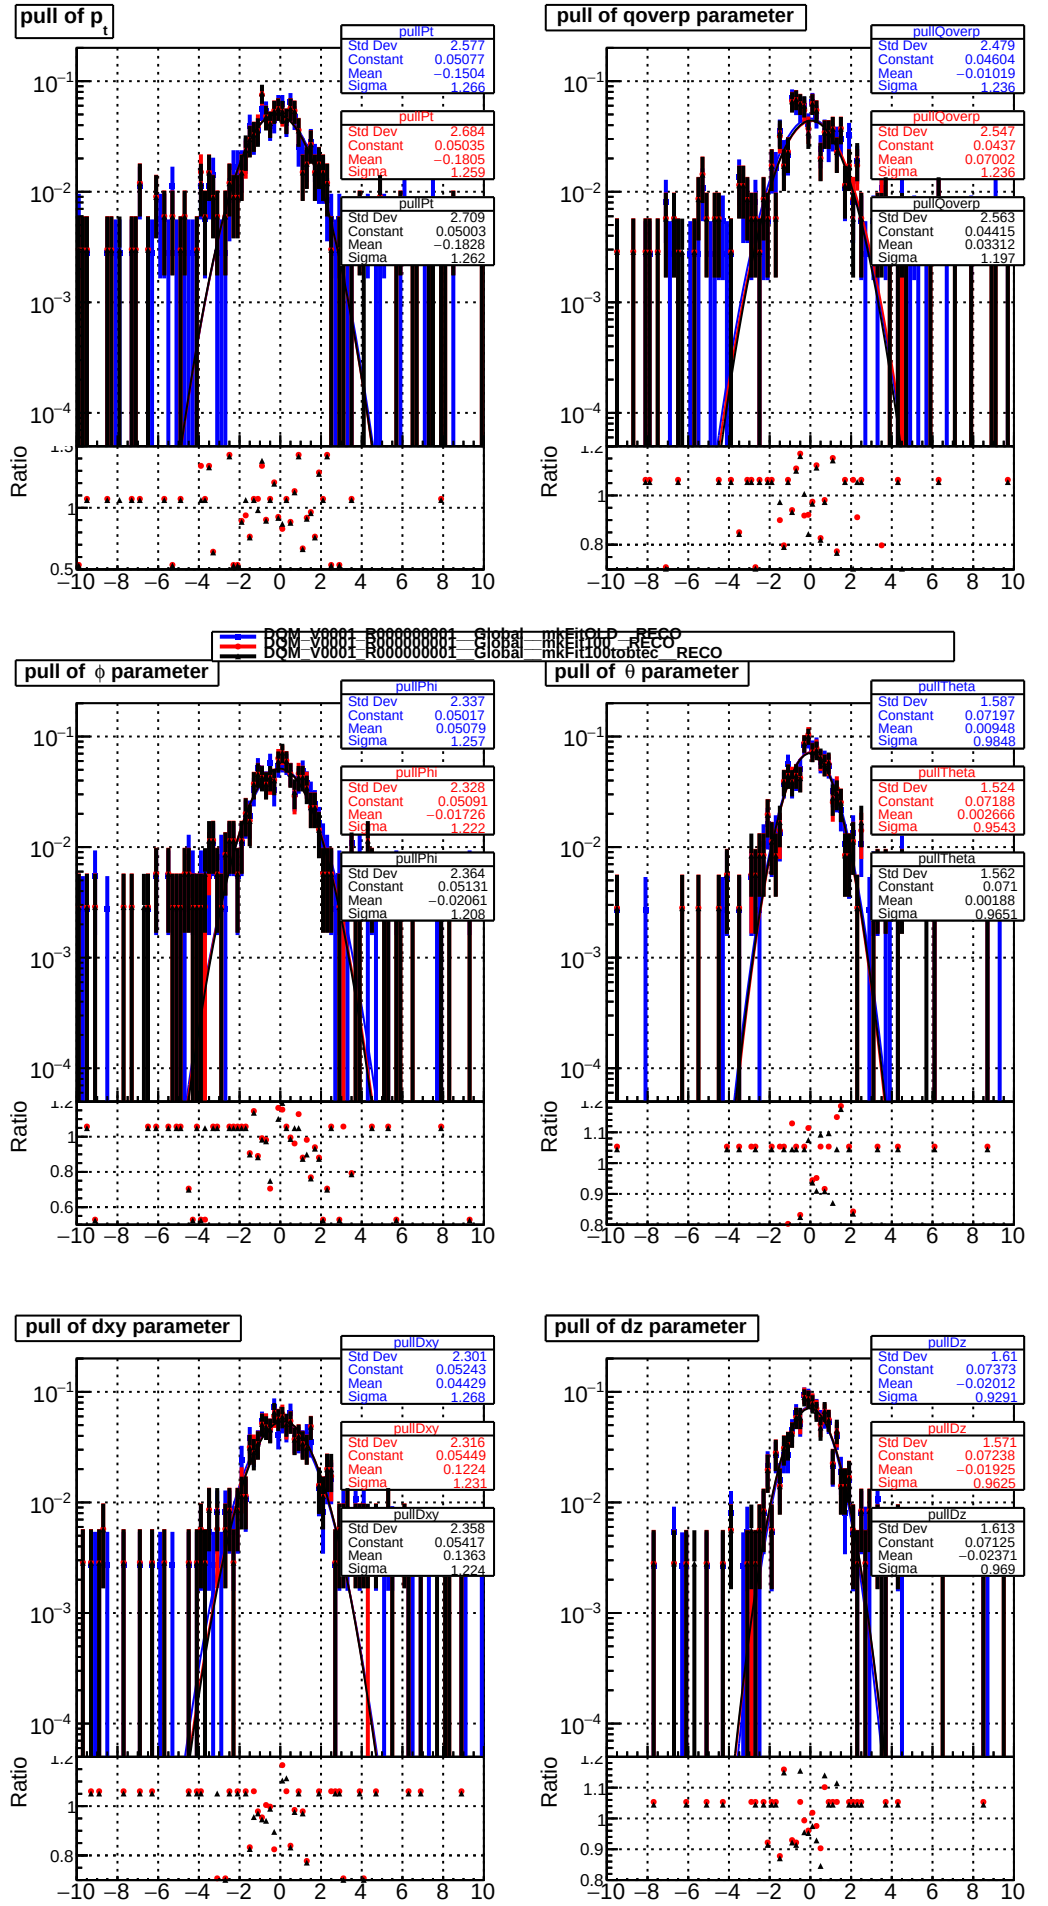
pull of p_t
pullPt
Std Dev 2.577
Constant 0.05077
Mean −0.1504
Sigma 1.266
pullPt
Std Dev 2.684
Constant 0.05035
Mean −0.1805
Sigma 1.259
pullPt
Std Dev 2.709
Constant 0.05003
Mean −0.1828
Sigma 1.262
pull of qoverp parameter
pullQoverp
Std Dev 2.479
Constant 0.04604
Mean −0.01019
Sigma 1.236
pullQoverp
Std Dev 2.547
Constant 0.0437
Mean 0.07002
Sigma 1.236
pullQoverp
Std Dev 2.563
Constant 0.04415
Mean 0.03312
Sigma 1.197
DQM_V0001_R000000001__Global__mkFitOld__RECO
DQM_V0001_R000000001__Global__mkFit100__RECO
DQM_V0001_R000000001__Global__mkFit100tobtec__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.337
Constant 0.05017
Mean 0.05079
Sigma 1.257
pullPhi
Std Dev 2.328
Constant 0.05091
Mean −0.01726
Sigma 1.222
pullPhi
Std Dev 2.364
Constant 0.05131
Mean −0.02061
Sigma 1.208
pull of θ parameter
pullTheta
Std Dev 1.587
Constant 0.07197
Mean 0.00948
Sigma 0.9848
pullTheta
Std Dev 1.524
Constant 0.07188
Mean 0.002666
Sigma 0.9543
pullTheta
Std Dev 1.562
Constant 0.071
Mean 0.00188
Sigma 0.9651
pull of dxy parameter
pullDxy
Std Dev 2.301
Constant 0.05243
Mean 0.04429
Sigma 1.268
pullDxy
Std Dev 2.316
Constant 0.05449
Mean 0.1224
Sigma 1.231
pullDxy
Std Dev 2.358
Constant 0.05417
Mean 0.1363
Sigma 1.224
pull of dz parameter
pullDz
Std Dev 1.61
Constant 0.07373
Mean −0.02012
Sigma 0.9291
pullDz
Std Dev 1.571
Constant 0.07238
Mean −0.01925
Sigma 0.9625
pullDz
Std Dev 1.613
Constant 0.07125
Mean −0.02371
Sigma 0.969
Ratio