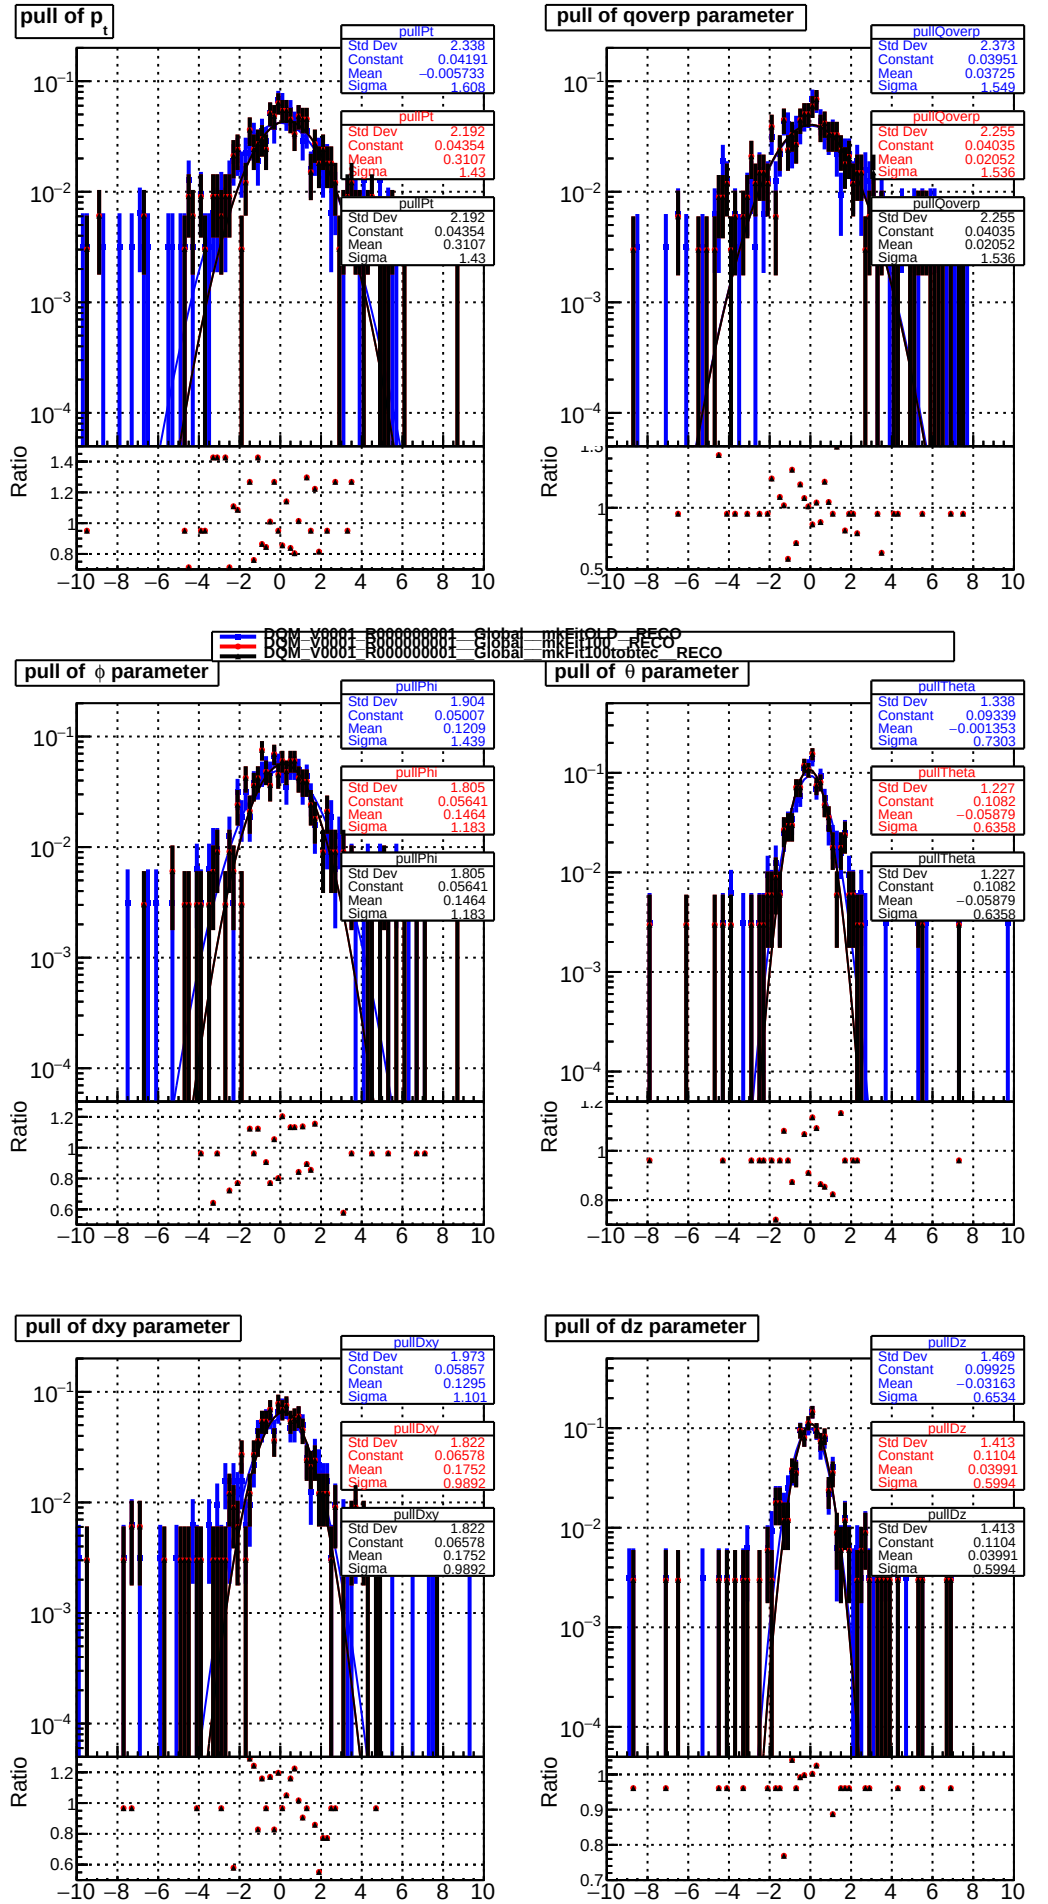
pull of $p_t$
pullPt
Std Dev 2.338
Constant 0.04191
Mean −0.005733
Sigma 1.608
pullPt
Std Dev 2.192
Constant 0.04354
Mean 0.3107
Sigma 1.43
pullPt
Std Dev 2.192
Constant 0.04354
Mean 0.3107
Sigma 1.43
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.373
Constant 0.03951
Mean 0.03725
Sigma 1.549
pullQoverp
Std Dev 2.255
Constant 0.04035
Mean 0.02052
Sigma 1.536
pullQoverp
Std Dev 2.255
Constant 0.04035
Mean 0.02052
Sigma 1.536
Ratio
DQM_V0001_R000000001__Global__mkFitOld__RECO
DQM_V0001_R000000001__Global__mkFit100__RECO
DQM_V0001_R000000001__Global__mkFit100tobtec__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.904
Constant 0.05007
Mean 0.1209
Sigma 1.439
pullPhi
Std Dev 1.805
Constant 0.05641
Mean 0.1464
Sigma 1.183
pullPhi
Std Dev 1.805
Constant 0.05641
Mean 0.1464
Sigma 1.183
Ratio
pull of θ parameter
pullTheta
Std Dev 1.338
Constant 0.09339
Mean −0.001353
Sigma 0.7303
pullTheta
Std Dev 1.227
Constant 0.1082
Mean −0.05879
Sigma 0.6358
pullTheta
Std Dev 1.227
Constant 0.1082
Mean −0.05879
Sigma 0.6358
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.973
Constant 0.05857
Mean 0.1295
Sigma 1.101
pullDxy
Std Dev 1.822
Constant 0.06578
Mean 0.1752
Sigma 0.9892
pullDxy
Std Dev 1.822
Constant 0.06578
Mean 0.1752
Sigma 0.9892
Ratio
pull of dz parameter
pullDz
Std Dev 1.469
Constant 0.09925
Mean −0.03163
Sigma 0.6534
pullDz
Std Dev 1.413
Constant 0.1104
Mean 0.03991
Sigma 0.5994
pullDz
Std Dev 1.413
Constant 0.1104
Mean 0.03991
Sigma 0.5994
Ratio